


# IN GROUND POOL BONDING

ALL METAL PARTS WITHIN 5' OF THE POOL MUST BE BONDED TO THE COPPER WIRE CIRCUIT TRAVELLING AROUND THE POOL. 





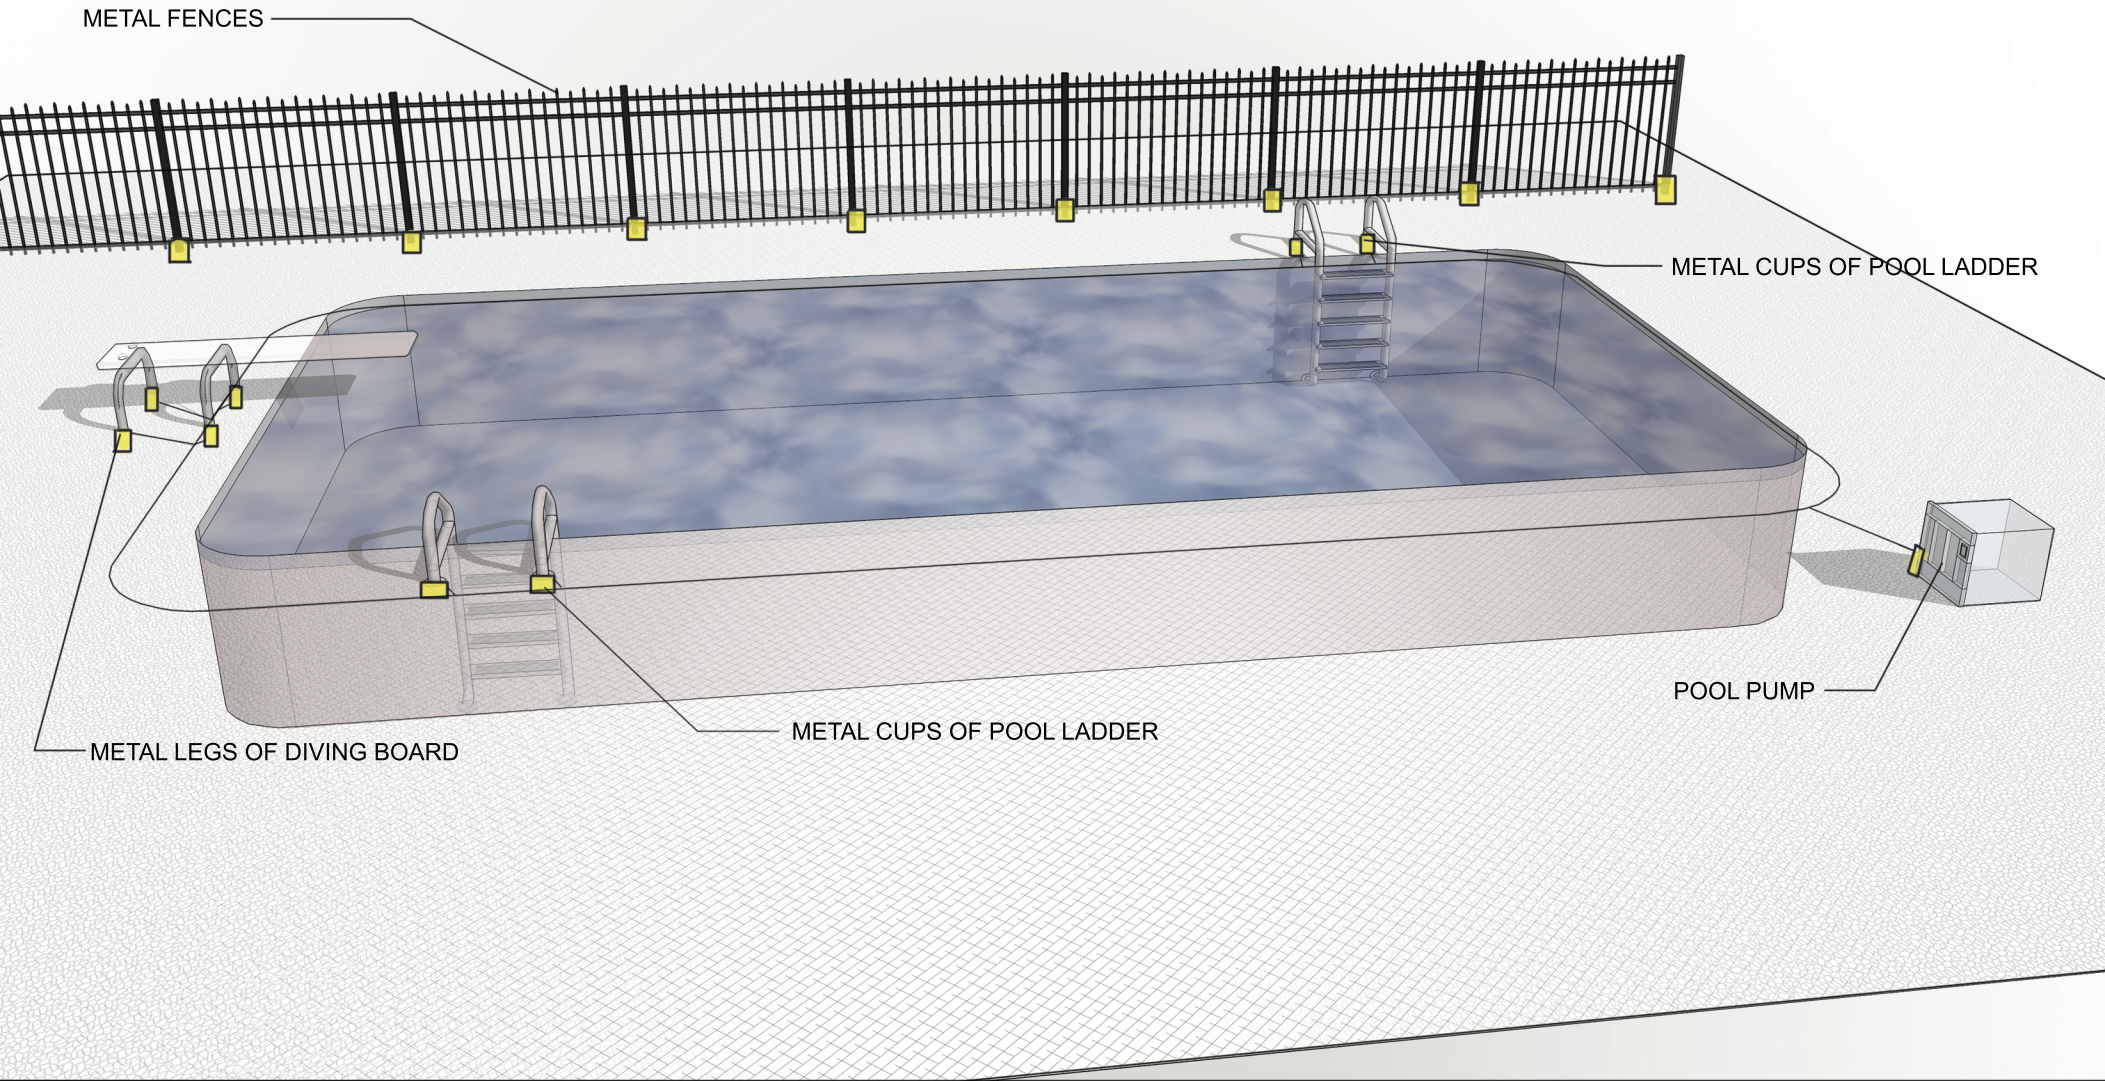

The diagram illustrates three concentric zones around a pool. The innermost zone is a light blue rectangle labeled 'PERMANENTLY INSTALLED POOL'. Surrounding it is a dark grey rounded rectangle labeled 'NO RECEPTACLES IN THIS ZONE'. The distance between the pool and this boundary is marked as '5\''. The outermost zone is a light grey rounded rectangle labeled 'PUMP RECEPTACLE ONLY, NO OTHER RECEPTACLES PERMITTED IN THIS ZONE'. The distance between the inner boundary and the outer boundary is marked as '10\''. The total distance from the pool to the outer boundary is marked as '20\''.

PUMP RECEPTACLE ONLY, NO OTHER  
RECEPTACLES PERMITTED IN THIS ZONE

PERMANENTLY INSTALLED POOL

NO RECEPTACLES IN THIS ZONE

\*\*RECEPTACLE IN THIS ZONE MUST BE SINGLE,  
LOCKING, GROUNDING, AND GFI PROTECTED

\*\*\*ALL 125 V RECEPTACLES MUST HAVE GFI PROTECTION.  
FOR DWELLING A 125V, 15 OR 20 AMP RECEPTACLE MUST BE  
LOCATED IN THIS ZONE